



## MC100 Interface Control Module

Enhanced Vapor Recovery (EVR) Executive Orders VR-201 & VR-202 includes the VP1000 Vacuum Assist Pump. As outlined in Exhibit 1 of these Executive Orders, the VP1000 is sold in many forms to suit the dispenser being upgraded. In all forms, the ARB approved Installation, Operation and Maintenance Manuals for the VP1000 details connection to the MC100 Interface Control Module. The MC100 Interface Module has been supplied in two versions; illustrations of both are shown below:

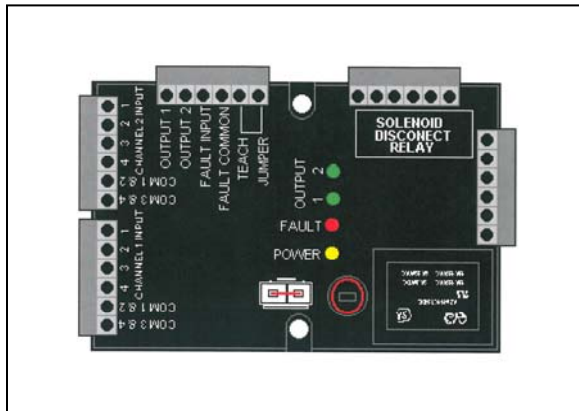

**Currently Supplied MC100**

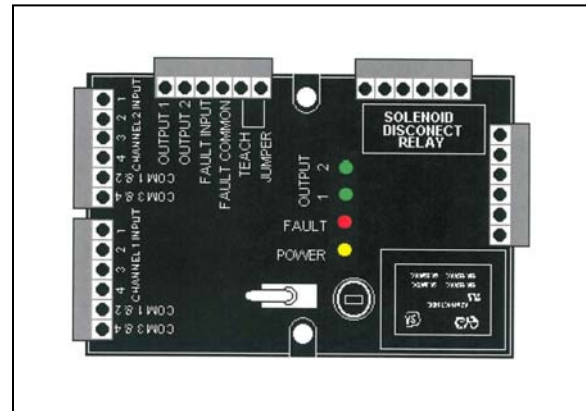

**Previously Supplied MC100**

The above two versions of the MC100 Interface Module are the only two controllers that can be used within Executive Order VR-201 & VR-202 EVR systems. Prior to the MC100, other controllers were certified for use with the VP1000, such as noted within Executive Order G-70-191. When sites currently installed per Executive Order G-70-191 are upgraded to EVR Executive Orders VR-201 & VR-202, the VP1000 must be controlled by one of the MC100 Interface Module shown above. Use of an Interface Module other than those shown above will result in a Notice of Violation (NOV) and penalties for use of non-CARB approved equipment.

Please contact FFS Technical Service if you have any questions regarding this bulletin.

Thank You,

Matt Johnson  
Applications Engineer  
Dispensing Systems

