



Franklin Electric
FUELING SYSTEMS

ANTI SYPHON VALVE

INSTALL GUIDE

F-1674 r4

MODEL NUMBER

60530011

60630011

61630011

61630012


61630013

63630011

63630012

63630031

63630032

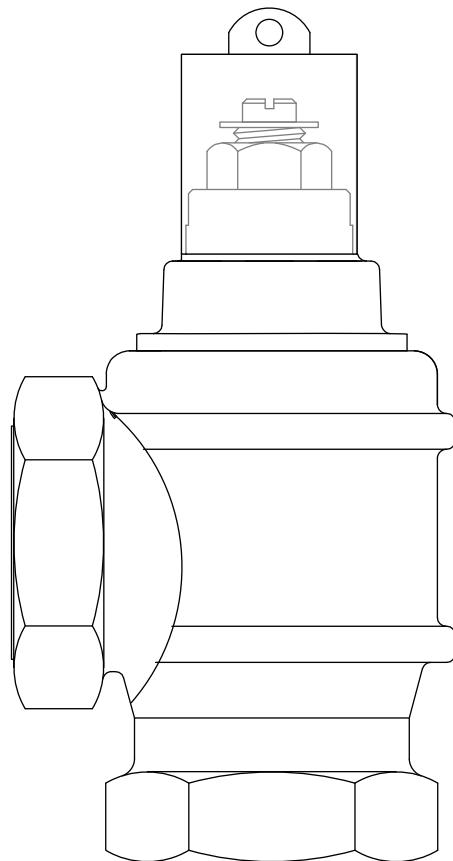

The information in this publication is provided for reference only. While every effort has been made to ensure the reliability and accuracy of the information contained in this manual at the time of printing, we recommend that you refer to "franklinfueling.com" for the most current version of this manual. All product specifications, as well as the information contained in this publication, are subject to change without notice. Franklin Electric does not assume responsibility and expressly disclaims liability for loss, damage, or expense arising out of, or in any way connected with, installation, operation, use, or maintenance by using this manual. Franklin Electric assumes no responsibility for any infringement of patents or other rights of third parties that may result from use of this manual or the products. We make no warranty of any kind with regard to this material, including, but not limited to, the implied warranties of merchantability and fitness for a particular purpose.

Copyright © 2023 Franklin Electric Co., Inc., Madison, WI 53718. All world rights reserved. No part of this publication may be stored in a retrieval system, transmitted, or reproduced in any way, including, but not limited to, photocopy, photograph, magnetic, or other record, without the prior written permission of Franklin Electric.

For technical assistance, please contact:

Franklin Electric
3760 Marsh Rd.
Madison, WI 53718
USA

Web: franklinfueling.com
Tel: +1 608 838 8786 • Fax: +1 608 838 6433
Tel: USA & Canada +1 800 225 9787 • Tel: UK +44 (0) 1473 243300
Tel: Mex 001 800 738 7610 • Tel: DE +49 6571 105 380 • Tel: CN +86 10 8565 4566

F-1674 r4

Conventions used in this manual

This manual includes safety precautions and other important information presented in the following format:

NOTE: This provides helpful supplementary information.

IMPORTANT: This provides instructions to avoid damaging hardware or a potential hazard to the environment, for example: fuel leakage from equipment that could harm the environment.

▲ CAUTION: This indicates a potentially hazardous situation that could result in minor or moderate injury if not avoided. This may also be used to alert against unsafe practices.

▲ WARNING: This indicates a potentially hazardous situation that could result in severe injury or death if not avoided.

▲ DANGER: This indicates an imminently hazardous situation that will result in death if not avoided.

Operating precautions

Franklin Electric equipment is designed to be installed in areas where volatile liquids such as gasoline and diesel fuel are present. Working in such a hazardous environment presents a risk of severe injury or death if you do not follow standard industry practices and the instructions in this manual. Before you work with or install the equipment covered in this manual, or any related equipment, read this entire manual, particularly the following precautions:

IMPORTANT: To help prevent spillage from an underground storage tank, make sure the delivery equipment is well-maintained, that there is a proper connection, and that the fill adaptor is tight. Delivery personnel should inspect delivery elbows and hoses for damage and missing parts.

▲ CAUTION: Use only original Franklin Electric parts. Substituting non-Franklin Electric parts could cause the device to fail, which could create a hazardous condition and/or harm the environment.

▲ WARNING: Follow all codes that govern how you install and service this product and the entire system. Always lock out and tag electrical circuit breakers while installing or servicing this equipment and related equipment. A potentially lethal electrical shock hazard and the possibility of an explosion or fire from a spark can result if the electrical circuit breakers are accidentally turned on while you are installing or servicing this product. Refer to this manual (and documentation for related equipment) for complete installation and safety information.

▲ WARNING: Before you enter a containment sump, check for the presence of hydrocarbon vapors. Inhaling these vapors can make you dizzy or unconscious, and if ignited, they can explode and cause serious injury or death. Containment sums are designed to trap hazardous liquid spills and prevent environmental contamination, so they can accumulate dangerous amounts of hydrocarbon vapors. Check the atmosphere in the sump regularly while you are working in it. If vapors reach unsafe levels, exit the sump and ventilate it with fresh air before you resume working. Always have another person standing by for assistance.

▲ WARNING: Follow all federal, state, and local laws governing the installation of this product and its associated systems. When no other regulations apply, follow NFPA codes 30, 30A, and 70 from the National Fire Protection Association. Failure to follow these codes could result in severe injury, death, serious property damage, and/or environmental contamination.

▲ WARNING: Always secure the work area from moving vehicles. The equipment in this manual is usually mounted underground, so reduced visibility puts service personnel working on it in danger from moving vehicles that enter the work area. To help prevent this safety hazard, secure the area by using a service truck (or some other vehicle) to block access to the work area.

▲ DANGER: Make sure you check the installation location for potential ignition sources such as flames, sparks, radio waves, ionizing radiation, and ultrasound sonic waves. If you identify any potential ignition sources, you must make sure safety measures are implemented.

Contents

1	Introduction.....	1
1.1	Documentation.....	1
1.1.1	Symbol Legend	1
2	Safety/Security	2
2.1	General Safety Information.....	2
2.2	Hazard Assessment	2
2.3	Required Personal Protective Equipment (PPEs)	2
3	Installation.....	3
3.1	Pre-Installation Inspection	3
3.2	Required Tools.....	3
3.3	Install Instructions	4
3.4	Adjustment Table.....	6

Intentionally Blank

1 Introduction

EBW™ Anti Syphon Valves are recommended for all aboveground storage applications to prevent fuel from exiting the storage tank in the event of a broken line or leak. The Anti Syphon Valve will shut-off product flow when lines are broken, preventing fuel spillage and fire hazards.

1.1 Documentation

- This document is intended for qualified and certified installation persons.
- Instructions in this document are in English. All other language versions are translations of this original document.
- Illustrations in this document show a typical setup and are for instruction and description purposes only.
- Information given in this document is given as a guide only. It is the installer's responsibility to ensure that correct and safe procedures are always followed.
- This document and related documents are available from:
Franklin Electric, www.franklinfueling.com.

1.1.1 Symbol Legend



Wear Protective Headwear



Wear Eye Protection



Wear Protective Clothing



Wear High-Visibility Clothing



Wear Protective Gloves



Wear Safety Footwear



Refer to instruction guide.



Ventilate Before & During Entering



Ensure Continuous Ventilation



Connect an earth terminal to the ground



Disconnect main plug from electrical outlet



Disconnect before carrying out maintenance or repair



General Warning



Warning: Electricity



Warning: Flammable Material



No open flame; Fire, open ignition source and smoking prohibited

2 Safety/Security

2.1 General Safety Information

- Only perform procedures in this document you are qualified and certified to perform.
- Personnel working on or with energized equipment must be authorized by relevant regulatory bodies to carry out such work and must have the appropriate training. Check with your employer and relevant regulatory body's rules for working with energized equipment.
- In case of inconsistency or contradiction between information contained in this document and any laws, rules and regulations, obey the stricter of the two.
- Keep unqualified personnel at a safe distance during installation.
- Always wear all required PPE on-site and during installation.
- If it is necessary to remove safety/security devices, immediately reinstall the safety/security devices after completing the work.

2.2 Hazard Assessment

Prior to beginning work and prior to recommencing work after leaving and returning to the worksite, a worksite, *pre-job hazard assessment* must be performed to identify safety and environmental needs. At a minimum, this hazard assessment should:

- Identify possible hazards and risks.
- Identify the safety needs of the job.
- Identify the correct procedures, practices and equipment.
- Eliminate unsafe conditions and actions from the worksite.
- Identify the need for personal protective equipment.
- Inspect equipment before use.
- Confirm sheaths of all cables are secured and undamaged.
- Confirm plugs and connectors are properly connected and serviceable.
- Perform ongoing risk assessment during the project.

2.3 Required Personal Protective Equipment (PPEs)

These PPEs are required during all phases of installation.



Wear Protective Clothing



Wear High-Visibility Clothing



Wear Protective Headwear



Wear Eye Protection



Wear Protective Gloves



Wear Safety Footwear

3 Installation




3.1 Pre-Installation Inspection

Upon Receipt of Item(s)

- Verify all items are in accordance with the order.
- Check all items for damage.
- If any item shows damage or is not in accordance with the order, inform Franklin Electric *immediately*.
- Remove the packaging material.
 - Follow all local laws, rules and regulations regarding disposal of discarded parts, packaging material or items and any subsequent components.

3.2 Required Tools

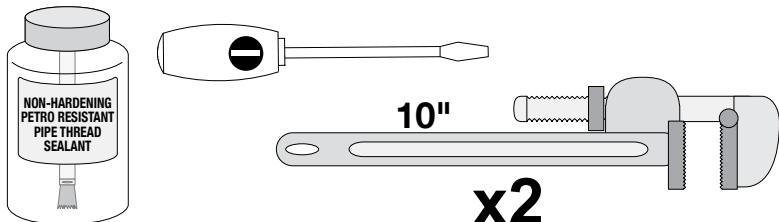

3.3 Install Instructions

NOTE: The anti siphon valve has a thermal relief valve that is set to 25 psi.

1. Determine the correct head height. Measure from the top of the fuel tank to the lowest run between the anti siphon valve and the pump.

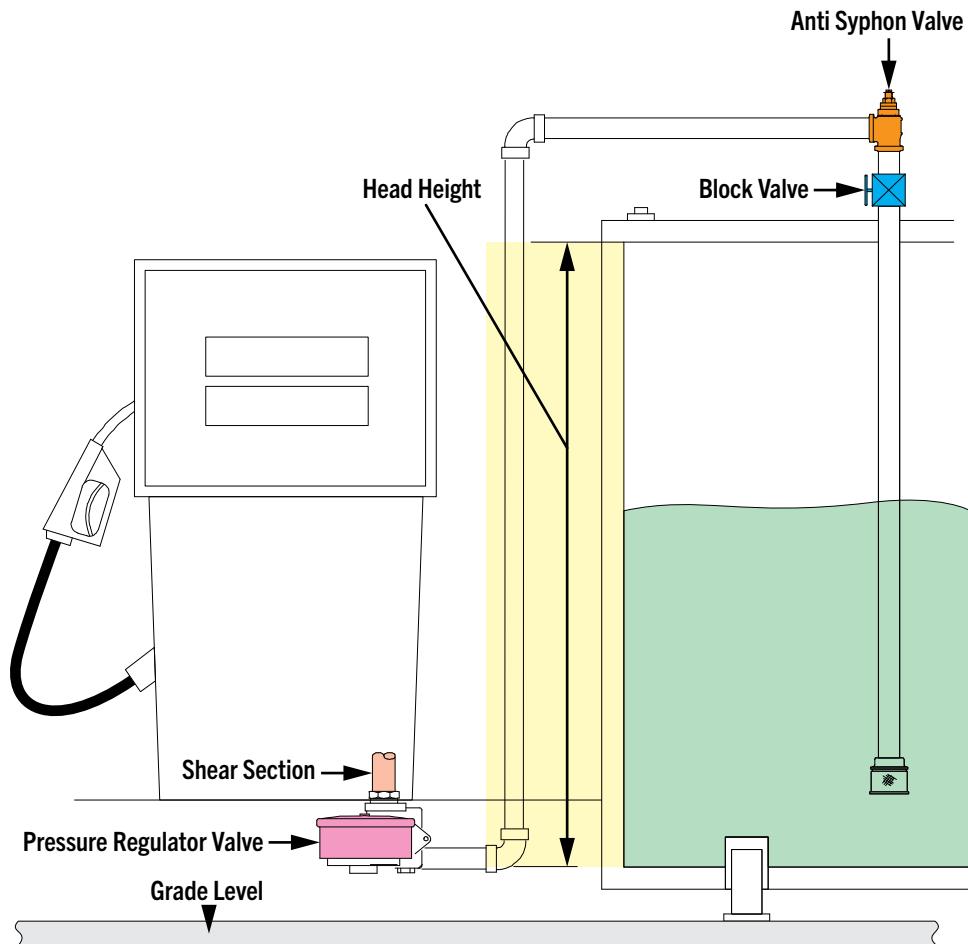


Figure 3.1

2. Order the corresponding part whose head range covers the measured site.
3. Install the inlet from the tank in the vertical axis (in line with adjustment head).
4. Install the outlet to the pump on the horizontal axis (perpendicular with inlet).
5. Valves as supplied are set to the maximum head. If necessary, adjust the valve to the desired head (see Figure 3.2). Refer to the Table 3.1 for setting dimensions.

NOTE: Apply a non-hardening, gasoline resistant thread sealant to the inlet and outlet threads to get a proper seal (see Figure 3.2).

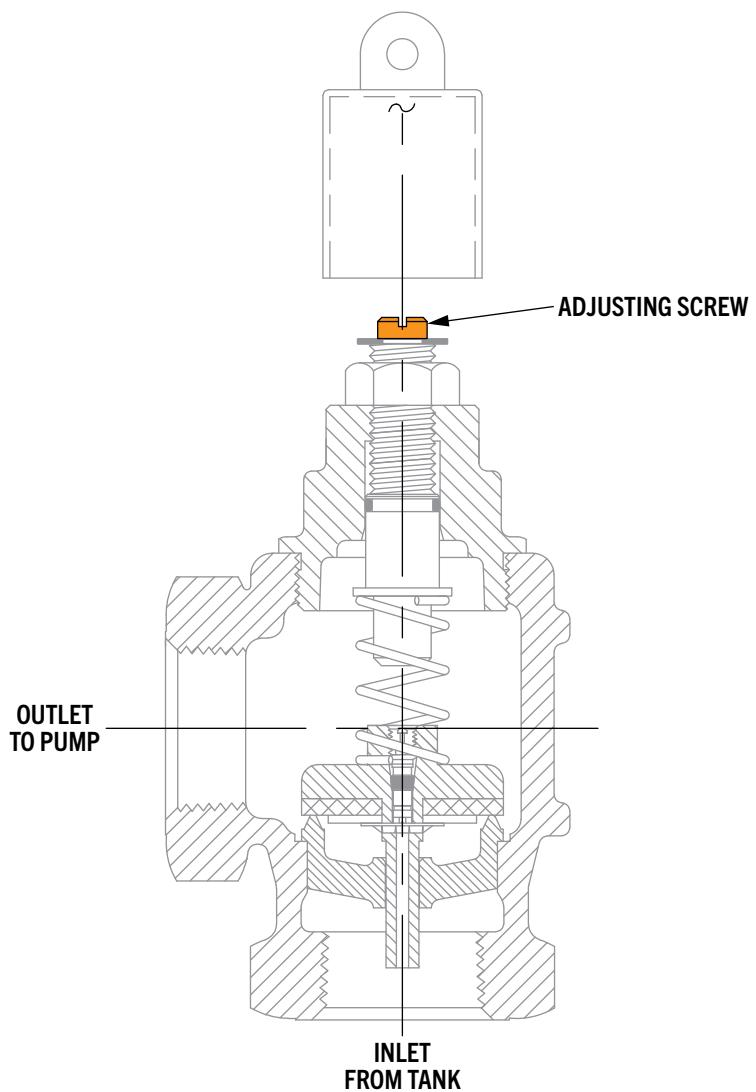


Figure 3.2

3.4 Adjustment Table


This table lists the turns from the factory setting.

TABLE 3.1 – Valve size and model number. \diamond = FACTORY SETTING*.

Feet of Head	$\frac{3}{4}$ "	1"	1½"			2"	
	60530011	60630011	61630011	61630012	61630013	63630011	63630012
1	5	5				5½	
2	5	5				4¼	
3	4	4				3	
4	3½	3½				1½	
5	3	3	6			\diamond^*	5
6	2½	2½	5¼				4½
7	2	2	4½				3¾
8	1½	1½	3½				3
9	1	1	2¾				2¼
10	¾	¾	1¾				1½
11	¼	¼	1				¾
12	\diamond^*	\diamond^*	\diamond^*	6		\diamond^*	5¼
13					5½		4¾
14					5¼		4½
15					4¾		4¼
16					4¼		3¾
17					3¾		3¼
18					3¼		3
19					2¾		2¾
20					2¼		2¼
21					1¾		1¾
22					1½		1½
23					1		1
24					½		½
25					\diamond^*		\diamond^*

*Valves ship at the factory setting, where the adjustment screw and nut are bottomed out so the retaining ring is in contact with the nut on top of the valve.

Intentionally Blank



Franklin Electric
—
FUELING SYSTEMS